

51.2V 300Ah Vetical Lithium Energy Storage Battery

USER INSTRUCTION



This manual introduces 51.2V 300Ah Vertical Lithium Energy Storage Battery. Please read this manual before you install the battery and follow the instruction carefully during installation process. Please contact immediately for advice and clarification if you have any question.

Contents

Catalogue

1. Symbol Description	4
2. Safety Precautions	5
2.1 Before Connecting	5
2.2 In Using	5
3.Introduction	6
4.Product Function Description	7
4.1 Dimensions	7
4.2 Equipment interface instruction	8
4.3 Product Specifications	9
4.4 Parallel Connection	9
4.5 Dial Code Switch Settings (parallel connection needed)	10
4.6 Communication Function	10
1)RS232 communication	10
2)RS485-1 / CAN main communication	11
3)RS485-2 communication for parallel connection	11
4.7 LED Indication Function	12
4.8 Sleep Mode	13
4.9 Awake Mode	13
5 . Electrical Specification	14
6. BMS	15
6.1 BMS System Schematic Diagram	15
6.2 BMS Parameter	15
7. Product Life	16
8. Transportation	16
9. Emergency Situations	16
9.1 Battery Leakage	16
9.2 On Fire	16
9.3 Wet Batteries	16
9.4 Damaged Batteries	16
10. Remarks	17
10.1Recycle and Disposal	17
Parts List	18
Maintenance Record	18

1. Symbol Description

	Do not place near open fire or flammable materials.
	A potential hazard exists when the equipment is working. Wear personal protective equipment during operation.
	Warning electric shock. Power off the equipment before any operation.
	Grounding: indicate PE cable connection position.
	Do not place in areas accessible to children.
	Keep the battery away from open fire or ignition sources.
	Read the product and operation manual before operating the battery system.
	Label for Waste Electrical and Electronic Equipment (WEEE) Directive (2012/19/EU).
	The certificate label for CE.
	Recycle label.

2. Safety Precautions



Alert

- 1) It is important and necessary to read the user manual carefully (and attachment) before installing or using battery. Failure to do so or to follow any instruction or warning in this document can result in electrical shock, serious injury, and death, or damage battery, potentially rendering it unusable.
- 2) When battery is stored for a long time, it is required to charge once every 6 months, and the SOC should be no less than 50%.
- 3) After battery module cannot be discharged, it needs to be recharged within 12h.
- 4) Do not connect power terminal reversely.
- 5) All power supplies must be disconnected during maintenance.
- 6) Please contact the supplier within 24 hours if there is something abnormal.
- 7) Do not use any liquid to clean the battery.
- 8) Do not expose battery to flammable or irritating chemicals or vapor.
- 9) Do not paint any part of battery, including any internal or external components.
- 10) Do not connect battery with PV solar wiring directly.
- 11) Do not install or use this product beyond provisions of the manual.
- 12) Direct or indirect damages caused by the above reasons are not covered by warranty claim.



Warning

2.1 Before Connecting

- 1) Please check the external packaging condition before unpacking. If it is damaged, contact corresponding local retailer.
- 2) After unpacking, please check the products and spare parts according to spare parts list. If the product is damaged or missing, please contact your local retailer.
- 3) Connect to specified matching inverter.
- 4) Before installation, be sure to cut off the grid power and make sure battery switch is on OFF mode.
- 5) It is prohibited to connect the battery and AC power directly.
- 6) All electrical wiring must be connected in accordance with local regulations.
- 7) Please ensure that electrical performance of battery system is compatible with the equipment.
- 8) The installation onsite shall be equipped with fire-fighting facilities that meet relevant requirements, such as fire sand, dry powder fire extinguisher, etc.

2.2 In Using

- 1) If battery system needs to be moved or repaired, power must be cut off and battery is completely shut down.

- 2) It is prohibited to connect battery with different types of battery.
- 3) Do not connect battery to faulty inverter.
- 4) Except for personnel from Company or other authorized personnel, batteries shall not be opened, repaired or disassembled. The company shall not bear any liability or responsibility caused by violation of any safety operation or design standard, production standard, equipment safety standards or any other standards or requirements.

3.Introduction

This stand mode LifePo4 lithium battery belongs to one of the series of household energy storage products that are independently designed and developed. It has long cycle life, high safety standard BMS software protection and strong housing, exquisite looks, and easy installation, etc. It is widely used in energy storage system with off- grid inverters, on-off grid inverters and hybrid inverters.

4.Product Function Description

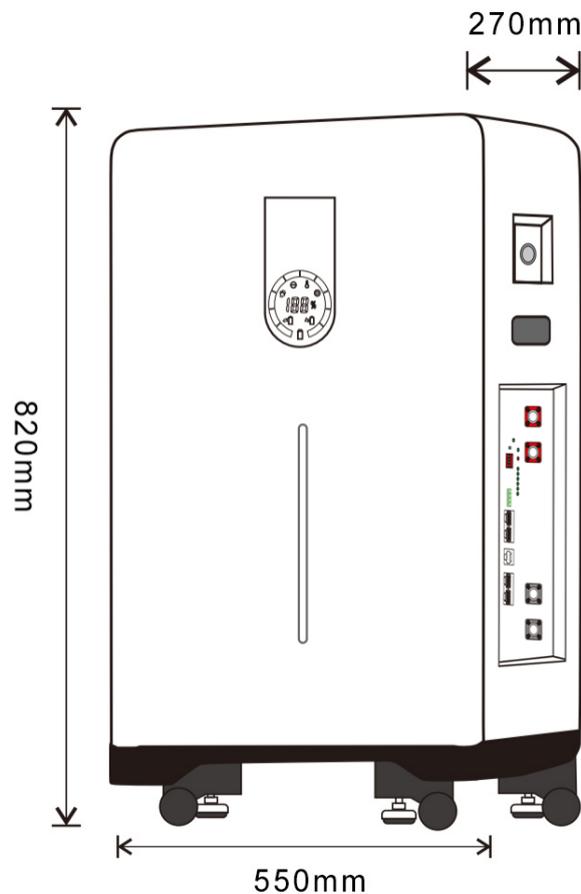


Figure 4-1

4.1 Dimensions

product model			
Specification	Length (L)	Width (W)	High (H)
51.2V300Ah	820mm	550mm	270mm

4.2 Equipment interface instruction


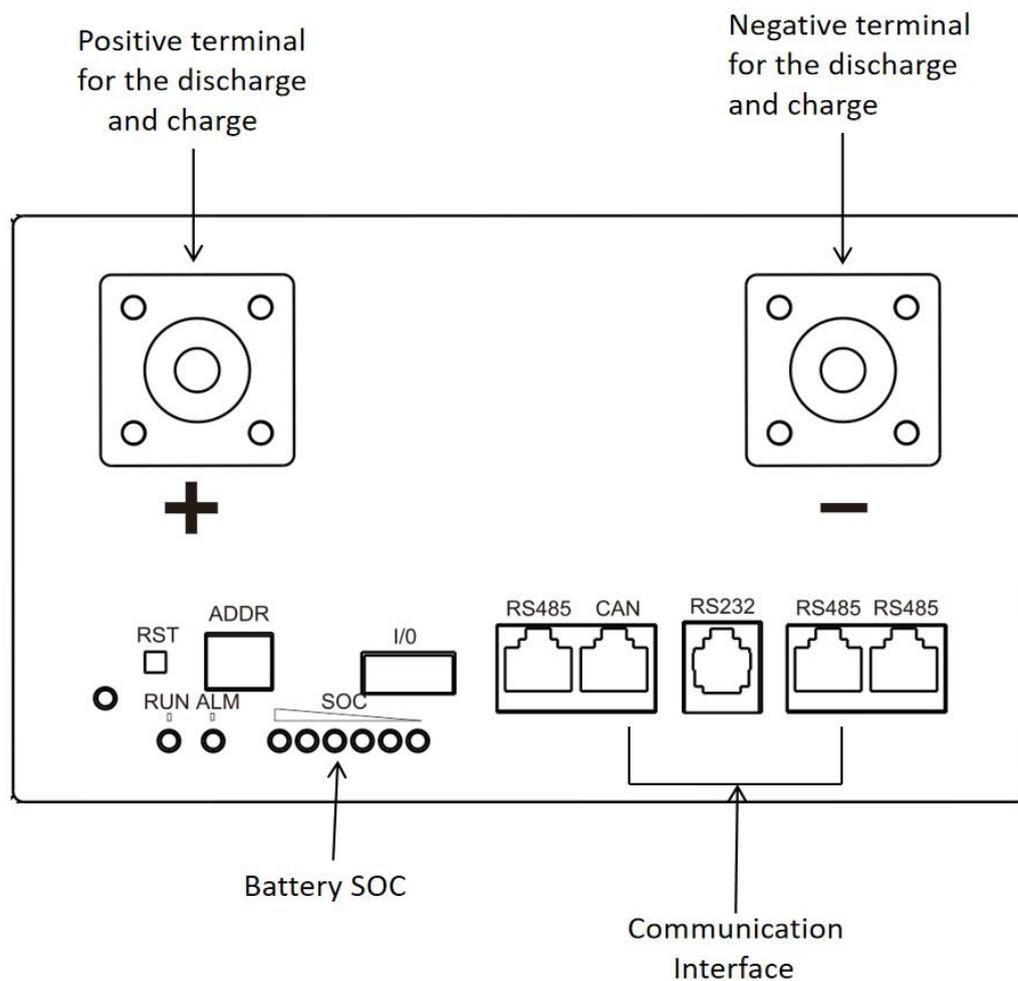



Figure 4-2

4.3 LCD Display

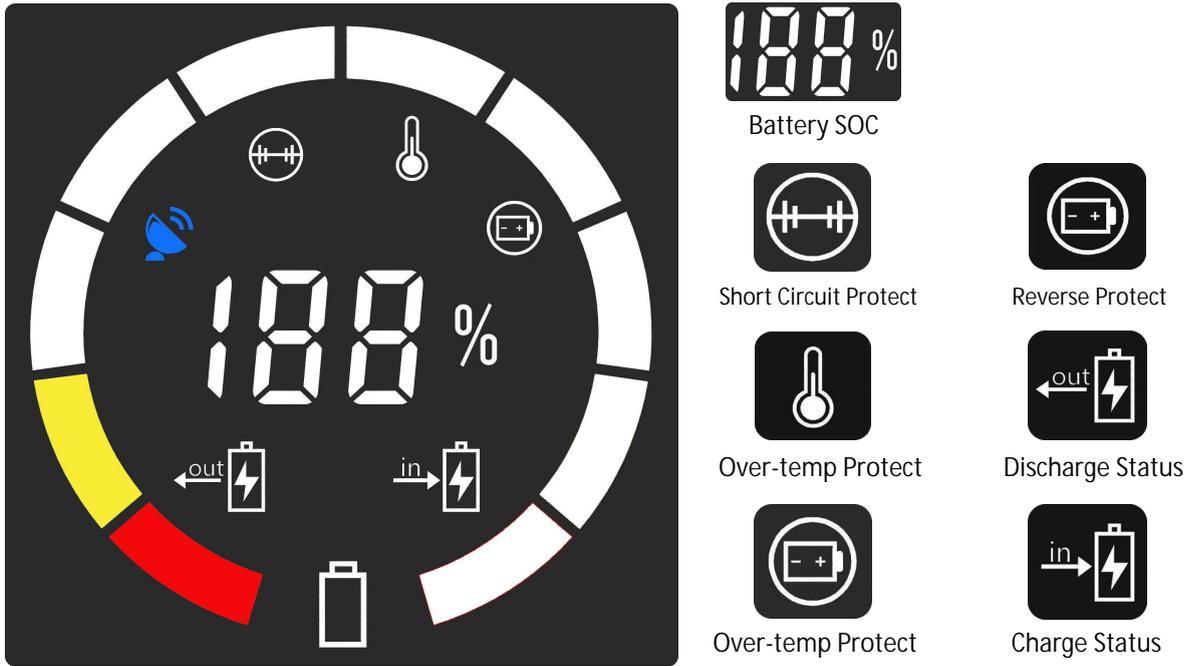

4.4 Parallel Connection


When Connect the batteries in parallel, connect the positive terminal and positive terminal (red colour) in parallel, and the negative terminal and negative terminal (black colour) in parallel, the max parallel quantity is 15pcs, as shown in the figure below:

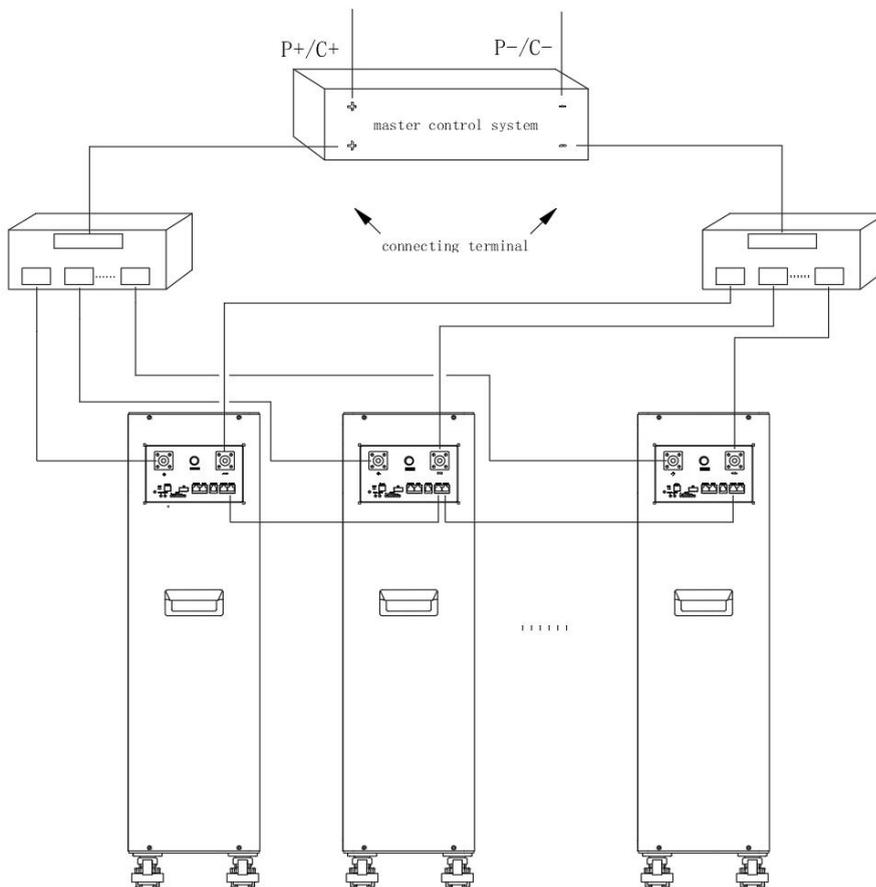

4.5 Product Specifications

Items		Condition	Specification
Nominal Capacity		Standard charge/discharge	300.0Ah
Nominal Voltage		Average	51.2V
Standard Charging Refer to 5.1		Constant current Constant voltage End current(Cut off)	100A 57.6V 1A
Charging Voltage		/	57.6V
Max. Continuous Charge Current		25±3°C	200.0A
Standard Discharging Refer to 5.2		Constant current End voltage(Cut off)	150.0A 43.2V
Max Continuous Discharge Current		25±3°C	200.0A
Nominal Energy		25±3°C	15.36KWh
Available Energy		25±3°C	13.82KWh
Operating Temperature	Charge	/	0°C ~ 55°C
	Discharge	/	-20°C ~ 55°C
Storage Temperature		1 month 3 month 6 month	-20°C ~ 45°C -20°C ~ 35°C -20°C ~ 25°C
Weight		/	~120KG

4.5 Dial Code Switch Settings (parallel connection needed)

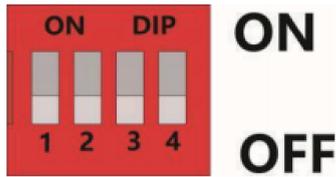


When the battery packs are connected in parallel, the dial code switch of each battery can be used to distinguish different Pack addresses. The hardware address can be set through the dial code switch on the board. The definition of the dial code switch refer to the following table.

ADD	Dial switch position			
	# 1	#2	#3	#4
1	ON	OFF	OFF	OFF
2	OFF	ON	OFF	OFF
3	ON	ON	OFF	OFF
4	OFF	OFF	ON	OFF
5	ON	OFF	ON	OFF
6	OFF	ON	ON	OFF
7	ON	ON	ON	OFF
8	OFF	OFF	OFF	ON
9	ON	OFF	OFF	ON
10	OFF	ON	OFF	ON
11	ON	ON	OFF	ON
12	OFF	OFF	ON	ON
13	ON	OFF	ON	ON
14	OFF	ON	ON	ON
15	ON	ON	ON	ON

4.6 Communication Function


1)RS232 communication



RS232 Port use 6P6C vertical RJ11 Socket	
RJ11 Pin	Define
Pin 2	NC(empty)
Pin 3	TX(computer receives data)
Pin 4	RX(computer sends data)
Pin 5	GND(ground)

BMS can communicate with the upper computer through RS232 interface, so that it can monitor all kinds of battery information, including battery voltage, current and temperature, working status etc. The default baud rate is 9600bps.

2)RS485-1 / CAN main communication

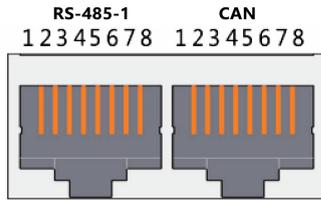


If you need to communicate with the monitoring device through RS485 or Can, the monitoring device will be used as the host, and the address setting range of other batteries will be 2~15 according to the polling data of the address.

The product adopts isolated communication design, supports RS485/CAN communication mode, RS485 communication default baud rate is 9600 bps, 8 bit data bit, 1 bit stop bit, no test bit; The default baud rate of CAN communication is 500Kbps;

RS485 & CAN use 8P8C vertical RJ45 socket			
RS485 PIN	Define	CAN PIN	Define
1、8	RS485-B1	1、2、3、6、8	NC
2、7	RS485-A1	5	CANL
3、6	GND	4	CANH
4、5	NC	7	GND

3)RS485-2 communication for parallel connection



With dual RS485 interfaces, the default baud rate is 9600bps. If you need to communicate the batteries in parallel with the monitoring device or inverter, you need to connect each battery with RS485-2 ports, so the host battery can read the information of each battery.

RS485-A & RS485- B use 8P8C vertical RJ45 socket			
RS485-A PIN	Define	RS485- B PIN	Define
1、8	RS485-B	1、8	RS485-B
2、7	RS485-A	2、7	RS485-A
3、6	GND	3、6	GND
4、5	NC	4、5	NC

4.7 LED Indication Function

The current power consumption and operation status of the product are shown through LED indicator Light (See Table 1, Table 2, and Table 3 for details) Working status indication

Status	Normal/ warning/ protection	ON/OFF	RUN	ALM	Battery capacity LED						Specification	
		●	●	●	●	●	●	●	●	●		
Power off	Dormancy	NO	NO	NO	NO	NO	NO	NO	NO	NO	NO	All NO
Ready mode	Normal	YES	Flash 1	NO	Indicate according to the battery capacity						Ready mode status	
	Warning	YES	Flash 1	Flash3							Module low voltage	
Charging	Normal	YES	YES	NO	Indicate according to the battery capacity(LED 2 flash when it indicate the highest battery capacity)						LED 2 flash when it is highest battery capacity, ALM do not flash when over-charging	
	Warning	YES	YES	Flash3								
	Over charging protection	YES	YES	NO	YES	YES	YES	YES	YES	YES	YES	If there is no mains power, the indicator turns to standby
	Temperature over current, failure protection	YES	NO	YES	NO	NO	NO	NO	NO	NO	NO	Stop charging
Discharging	normal	YES	Flash3	NO	Indicate according to the battery capacity							
	warning	YES	Flash3	Flash3								
	Under voltage protection	YES	NO	NO	NO	NO	NO	NO	NO	NO	NO	Stop discharging
	Over temperature, current, short circuit, reverse connection, failure protection	YES	NO	YES	NO	NO	NO	NO	NO	NO	NO	Stop discharging
Invalid a tion		NO	NO	YES	NO	NO	NO	NO	NO	NO	NO	Stop charging and discharging

Capacity Indicator

Status		Charging						Discharging					
Capacity dictator		L6	L5	L4	L3	L2	L1	L6	L5	L4	L3	L2	L1
		●	●	●	●	●	●	●	●	●	●	●	●
Battery level (%)	0~16.6%	NO	NO	NO	NO	NO	Flash2	NO	NO	NO	NO	NO	YES
	16.6~33.2%	NO	NO	NO	NO	Flash 2	YES	NO	NO	NO	NO	YES	YES
	33.2~49.8%	NO	NO	NO	Flash 2	YES	YES	NO	NO	NO	YES	YES	YES
	49.8~66.4%	YES	YES	Flash2	YES	YES	YES	NO	NO	YES	YES	YES	YES
	66.4~83.0%	NO	Flash2	YES	YES	YES	YES	NO	YES	YES	YES	YES	YES
	83.0~100%	Flash 2	YES	YES	YES	YES	YES	YES	YES	YES	YES	YES	YES
Working dictator ●		YES						Flash 3					

LED Flashing Instructions

Flash way	Bright	NO
Flash 1	0.25S	3.75S
Flash 2	0.5S	0.5S
Flash 3	0.5S	1.5S

Note:

The LED indicator alarm can be enabled or disabled through the host computer.
The factory default is enabled.

4.8 Sleep Mode

The system enters a low-power mode when any of the following conditions is met:

1. The monomer or overall over release protection is not removed within 30 seconds.
2. Press the button (3~6S) and release the button.
3. The lowest unit voltage is lower than the dormancy voltage, and the duration reaches the dormancy delay time (at the same time, meet the no communication, no protection, no equilibrium, no current).
4. The standby time is more than 24 hours (no communication, no charge and discharge, no city power).
5. Force the shutdown through the upper computer software. Before entering hibernation, ensure that the input is not connected with external voltage, otherwise it cannot enter the low power mode.

4.9 Awake Mode

When the system is in the low power mode and meets any of the following conditions, the system will exit the low power mode and enter the normal operation mode:

1. Access to the charger, and the output voltage of the charger shall be greater than 48V.
2. Press the button (3~6S) and release the button.


5. Electrical Specification

(Unless there is special requirement, the test shall be done under temperature of $25 \pm 2^\circ\text{C}$ and with relative humidity of 45~85%.)

Items	Test Condition				Standard
5.1 Standard Charge	The standard charge means charge the battery in temperature below $25 \pm 3^\circ\text{C}$ with initial charge current of 100A(300Ah) and with constant voltage of 57.6V, then charge with constant voltage of 57.6V and with floating current taper to 1A(300Ah) cut-off (Charger should be exclusively designed for lithium battery, with an accuracy of $\pm 0.05\text{V}$) within 6 hours.				/
5.2 Standard Discharge	After battery is charged fully in accordance with the standard and then discharge to voltage 43.2V with discharge current 150A(300Ah).The minimum gap time between charge and discharge period is 30 minutes.				Minimum Capacity $\geq 95\%$ Capacity
5.3 Cycle Life	After the completion of 0.2C charge and 30 minutes' rest, discharge to 80% DOD with constant current of 0.2C in the ($25 \pm 3^\circ\text{C}$) environment, then carry out the next cycle, after 6000 cycles, rest it for 1 day and test the capacity.				Capacity $\geq 80\%$ Minimum Capacity
5.4 Discharge Character	Discharge current	Discharge Temperature			At -10°C : Discharge Capacity $\geq 50\%$ At 0°C : Discharge capacity $\geq 80\%$ At 25°C Discharge capacity $\geq 100\%$ At 40°C Discharge capacity $\geq 100\%$
	0.5C	-10°C	0°C	25°C 40°C	
	Batteries shall be charged according to 5.1 and discharged in accordance with the above mentioned temperature. The discharge capacity shall meet the standard. Batteries shall be stored for 6~8 hours at the test temperature.				

6. BMS

6.1 BMS System Schematic Diagram

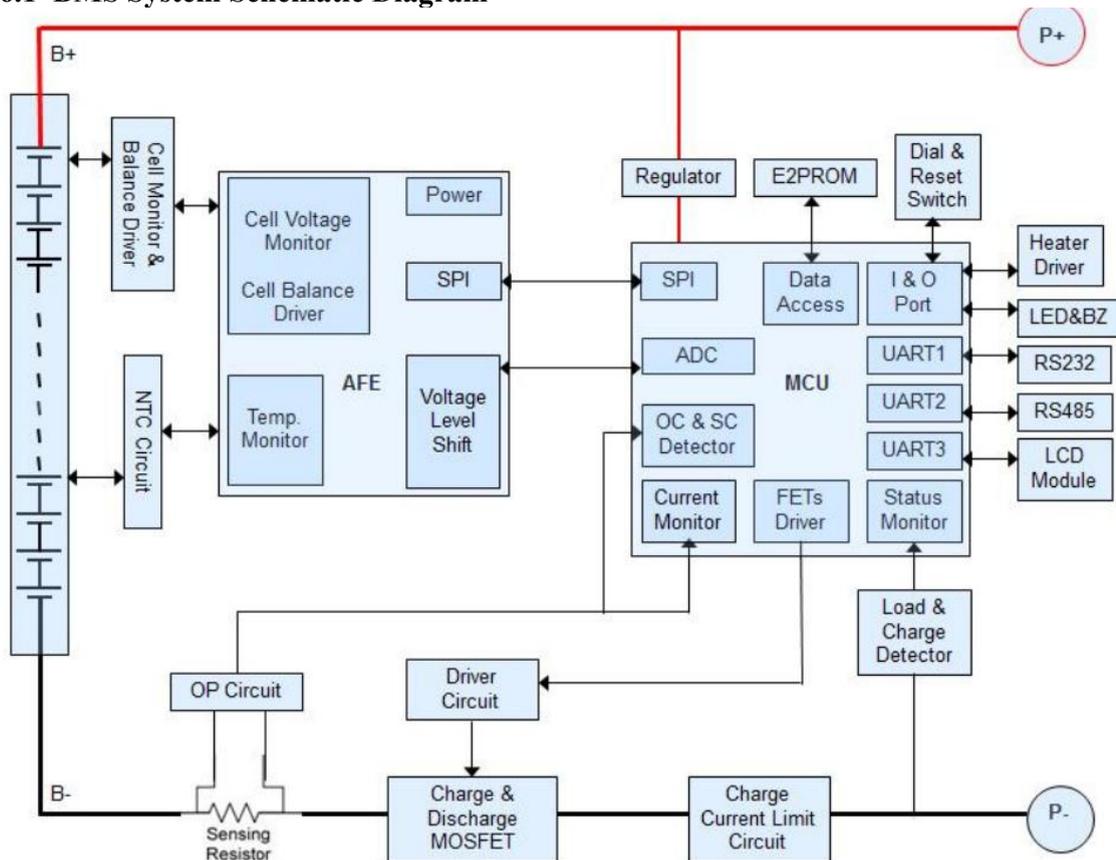

6.2 BMS Parameter

No.	Item	51.2V 300Ah
1	Power Consumption	Low power consumption mode $\leq 100\mu\text{A}$
2	Over charge Protection	Over charge detection voltage 3.65V
		Over charge release voltage 3.38V
3	Over discharge protection	Over discharge detection voltage 2.7V
		Over discharge release voltage 2.95V
4	Over current protection	Charging over current detection current (detection time) 205A (1S)
		Discharging over current detection current 1 (detection time) 205A (1S)
		Discharging over current Detection current2 (detection time) $\geq 250\text{A}$ 500ms
5	Temp. Protection	Detection temperature $65 \pm 2\text{C}$
6	Balance	Balance voltage 3.5V

7. Product Life

The design life of this product is 10 years.

8. Transportation

During transportation, please keep the battery from acutely vibration, impacting, over-exposure to the sun and drenching.

9. Emergency Situations

9.1 Battery Leakage

If the battery pack leaks electrolyte, avoid contact with the leaking liquid or gas. If one is exposed to the leaked substance, immediately perform the actions described below.

- 1)Inhalation: Evacuate contaminated area and seek medical aid.
 - 2)Contact with eyes: Rinse eyes with flowing water for 15 minutes and seek medical aid.
 - 3)Contact with skin: Wash affected area thoroughly with soap water and seek medical aid.
- Ingestion: Induce vomiting and seek medical aid.

9.2 On Fire

NO WATER!

Only dry powder fire or carbon dioxide extinguisher can be used; if possible, move the battery module to a safe area before it catches fire.

9.3 Wet Batteries

If the module is wet or submerged in water, do not let people access it, then contact us or an authorized dealer for technical support. Cut off all power switch on inverter side.

9.4 Damaged Batteries

Damaged batteries are dangerous and must be handled with utmost care. They are not fit for use and may pose a danger to people or property. If the module seems to be damaged, pack it in its original container, then return it to authorized dealer.




Warning

Damaged batteries may leak electrolyte or produce flammable gas.

10. Remarks

10.1 Recycle and Disposal

In case a battery (normal condition or damaged) needs disposal or needs recycling, it shall follow the local recycling regulation (Suggest Regulation (EC) N° 1013/2006 among European Union) to process, and using the best available techniques to achieve a relevant recycling efficiency.



Parts List

Item	Part Name	Description	Unit	Quantity
1	Network line	1 meters network line	PCS	1
2	Network cable	2 meters of inverter communication network cable	PCS	1
3	Positive and negative pole line	A pair of red and black 0.8 meters parallel positive and negative electrode line 4	PCS	1
4				
5				
6				
7				
8				
9				

Maintenance Record

Dear user, thank you for selecting our product, Please fill in and keep the warranty card for better services.

Attn: _____ Product No. : _____

Tel : _____ E-mail: _____

Purchase Date: _____

Address: _____

Maintenance Record			
Date of repair	Content	Maintenance Personnel	Note